

## Technical Data for XLPE Insulated Cables

Four-core cable with aluminium sector shaped solid conductors, XLPE insulation, concentric copper conductor, PVC oversheath

### General Description:


Cable code:	75152310126131
Standard specification:	BS 7870-3.40
Type of cable:	XLPE/NE(WAVEFORM)/PVC
Rated voltage U <sub>0</sub> /U (U <sub>max</sub> ):	0.6/1 (1.2) kV
Number of cores x Nominal cross-section:	4x185 mm <sup>2</sup>
Approximate cable overall diameter:	48 mm
Approximate cable overall weight:	4.2 kg/m
Nominal drum length (Tolerance):	250 m (± 0%) Approx. external drum dimensions (height x width, m): 2.00 x 1.10 Approx. drum gross weight: 1550 kg

Oversheath marking by embossing in two lines as follows:

- CABLEL 0317 2016\* ELECTRIC CABLE 600/1000V BS 7870-3.40 Batch No  
ELECTRIC CABLE 600/1000V BS 7870-3.40 4x185 AL  
\* Year of manufacture

Meter marking at one-meter intervals by ink on oversheath

### Cable structure:

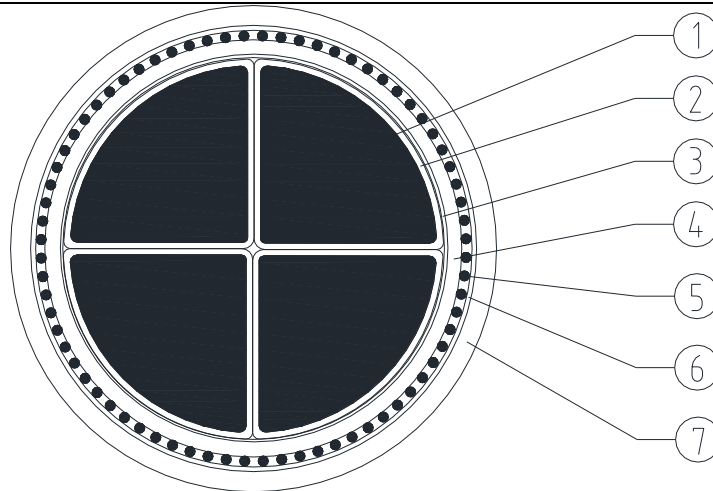

#### 1 - Conductor:

Aluminium sector shaped solid class 1 (maximum DC resistance according BS EN 60228, geometrical shape according to BS 3988) of nominal cross-section equal to 185 sq.mm.

#### 2 - Insulation:

XLPE type DIX3 according to BS 7870-1 of 1.6 mm minimum average thickness.

Core identification (skin colouration): Blue - Brown - Black - Grey

#### 3 - Binding tape.

#### 4 - Extruded rubber filling compound.

#### 5 - Concentric conductor:

Copper wires concentrically applied over core with a waveform lay with a structure of approximate 41x1.88mm.

#### 6 - Binding tape.

#### 7 - Sheath:

PVC type DMV 23 according to BS 7870-1 of 2.6 mm minimum average thickness with UV additive.

Sheath colour: Black

### Notes:

- The cables are fully tested according to BS 7870-3.40.

Y.Σ.:	2318/2015	Cable Engineering Department	
T.M.K.:	578/2015	Issued by:	M. Papagiannis
Date - Revision:	18/08/2017 - 1	Reviewed by:	P. Kolios - K. Tastavridis
Client - Destination country:	ENW - UK	Approved by:	G. Georgallis

<b>Electrical Data:</b>		
Frequency:	50	Hz
Maximum conductor's temperature at continuous operation:	90	°C
Maximum conductor DC resistance at 20°C:	0.164	Ω/km
Calculated conductor AC resistance at maximum operating temperature:	0.22	Ω/km
Maximum DC resistance of concentric conductor at 20°C:	0.164	Ω/km
Calculated inductive reactance:	0.070	Ω/km
Calculated phase capacitance:	0.815·10 <sup>6</sup>	pF/km
Calculated charging current: <i>Based on the calculated phase capacitance and operating phase-to-ground voltage</i>	0.15	mA/m/phase
Zero sequence impedance: <i>Return through metallic sheath only, resistance calculated at 20°C</i>	0.652+j·0.083	Ω/km
<b>Continuous current carrying capacity of cables:</b>		
<b>A</b>	- Cable laid directly in ground - Soil thermal resistivity: 1.2 K.m/W - Depth of laying (top of the cables): 0.45 m - Ground temperature: 15 °C, - Load factor: 1.0 - One cable	
	Current:	346 A, for each phase
<b>B</b>	- Cable laid directly in ground - Soil thermal resistivity: 0.9 K.m/W - Depth of laying (top of the cables): 0.45 m - Ground temperature: 15 °C, - Load factor: 1.0 - One cable	
	Current:	380 A, for each phase
<b>C</b>	- Cable in single way PE ducts of 150mm internal diameter - Soil thermal resistivity: 1.2 K.m/W - Depth of laying (top of the cables): 0.45 m - Ground temperature: 15 °C, - Load factor: 1.0 - One cable	
	Current:	298 A, for each phase
<b>D</b>	- Cable in single way PE ducts of 150mm internal diameter - Soil thermal resistivity: 0.9 K.m/W - Depth of laying (top of the cables): 0.45 m - Ground temperature: 15 °C, - Load factor: 1.0 - One cable	
	Current:	312 A, for each phase
<b>E</b>	- Cable laid in air (not exposed in sunlight) - Air temperature: 25 °C - Load factor: 1.0 - One cable	
	Current:	355 A, for each phase
<b>Maximum pulling force with pulling head attached on one conductor:</b>		
	565	kgF
<b>Maximum pulling force with pulling stocking:</b>		
	2260	kgF
<b>Minimum dynamic bending radius during installation directly in ground:</b>		
	400	mm
<b>Minimum static bending radius adjacent to joints or termination with former:</b>		
	400	mm

Y.Σ.:	2318/2015	Cable Engineering Department	
T.M.K.:	578/2015	Issued by:	M. Papagiannis
Date – Revision:	18/08/2017 – 1	Reviewed by:	P. Kolios - K. Tastavridis
Client – Destination country:	ENW - UK	Approved by:	G. Georgallis

Υ.Σ.:	2318/2015	Cable Engineering Department	
T.M.K.:	578/2015	Issued by:	M. Papagiannis
Date - Revision:	18/08/2017 - 1	Reviewed by:	P. Kolios - K. Tastavridis
Client - Destination country:	ENW - UK	Approved by:	G. Georgallis