



Kirk Sandall Industrial Estate, Doncaster, South
Yorkshire, DN3 1QR

+44 (0)1302 310 113
enquiries@prosolveproducts.com
www.prosolveproducts.com

ProSolve is trademark of S.T.L Trading Company
Limited
Reg in England No: 5230722
VAT Reg No: 381 3533 58

TECHNICAL DATA SHEET

ProSolve™ Detectable Mesh

CONFORMITY

ProSolve manufactures and tests this product to comply with BS EN12613:2021

Our range of underground warning mesh is manufactured to this European norm. The ProSolve technical dept ensures consistent quality and standards which are maintained to conform to BS EN 12613:2021

PRODUCTS

Electric Cable (PVMESHELECT)

Fibre Optic Cable (PVMESHFIBREO)

Gas Pipe (PVMESHGAS)

Sewer Pipe (PVMESHSEWER)

Street Lighting Cable (PVMESHSTREETLT)

Water Pipe (PVMESHWATER)

DESCRIPTION

A plastic mesh used to help detect the presence of a underground pipe.




Kirk Sandall Industrial Estate, Doncaster, South
Yorkshire, DN3 1QR

+44 (0)1302 310 113
enquiries@prosolveproducts.com
www.prosolveproducts.com

ProSolve is trademark of S.T.L Trading Company
Limited

Reg in England No: 5230722

VAT Reg No: 381 3533 58

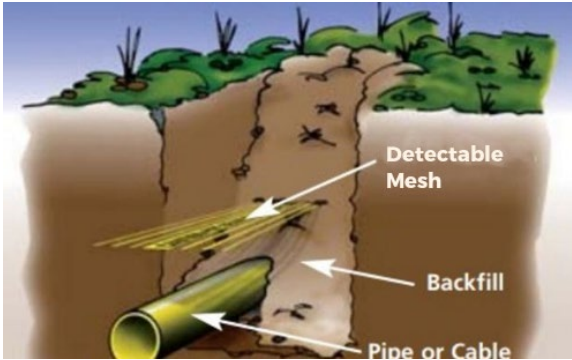

MESH STRUCTURE


230mm x 100m

100% virgin HDPE material with anti-UV.

Weight of HDPE: 60gsm

Detectable steel wire is 304 grade stainless steel, 0.4~0.5mm diameter

Printed area on tape: 50mm width, 100m length

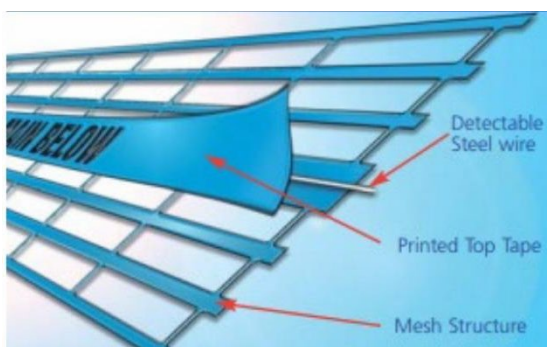



Kirk Sandall Industrial Estate, Doncaster, South
Yorkshire, DN3 1QR

+44 (0)1302 310 113
enquiries@prosolveproducts.com
www.prosolveproducts.com

ProSolve is trademark of S.T.L Trading Company
Limited
Reg in England No: 5230722
VAT Reg No: 381 3533 58

TEST REPORT DETAILS

These test details are in reference to EN 12613:2021

Device tested: Type 2 mesh manufactured from plastic to warn of the presence of underground cables or pipes during excavation.

TEST	RESULT
Appearance and Colour Fastness The appearance, colouring and marking of the warning device shall not exhibit any change when tested in accordance with tests. Tested to EN ISO 175.	PASS (all colours)
Dimensions The width of the Type 2 warning device strand should be $\geq 2\text{mm}$	PASS (all colours)
Tensile withstand strength The Type 2 warning device shall withstand a load of 300N during 1 min in longitudinal direction without starting to separate of any weak points (if any) and shall not exhibit a reduction of more than 20% of its width after removal of the load.	PASS (all colours)
Flatness When tested the warning device shall not exhibit a gap between any point of the warning device and surface of more than width divided by 4. Test is a 10m long section is spread on a flat surface without stretching for 60 seconds.	PASS (all colours)
Visual warning characteristics When tested (using a simulated trench and excavator bucket) the warning device left a single part greater than 200mm outside of the simulate bucket, and this visible piece was greater than 2mm in width.	PASS (all colours)
Resistance to UV-light The warning device conforms to EN ISO 4892-1 and its subsequent parts.	PASS (all colours)



Kirk Sandall Industrial Estate, Doncaster, South
Yorkshire, DN3 1QR

+44 (0)1302 310 113
enquiries@prosolveproducts.com
www.prosolveproducts.com

ProSolve is trademark of S.T.L Trading Company
Limited
Reg in England No: 5230722
VAT Reg No: 381 3533 58

Resistance of printing The warning device conforms to EN 60898-1:2019, 9.3.	PASS (all colours)
---	-----------------------

IMPORTANT NOTICE

All statements, technical information and recommendations are based on tests we believe to be reliable as at the date of hereof, but the accuracy or completeness thereof is not guaranteed. Please ensure before using the product that it is suitable for your intended use. Since the conditions and methods of use of the product and of the information referred to herein are beyond our control, other than for fraudulent misrepresentation, ProSolve expressly disclaims any and all liability as to any results obtained or arising from any use of the product or reliance on such information.